


Installing of TIS Tronic 260U regulator instead of TIS Tronic 83 regulator for TIS UNI, TIS HARD PLUS 150 boilers.

Note: Before installing TIS Tronic 260U regulator, previous TIS Tronic 83 regulator must be removed from the boiler with casing.


Step 1.

Bend the adapter plate(liner), up to 90° deg angle

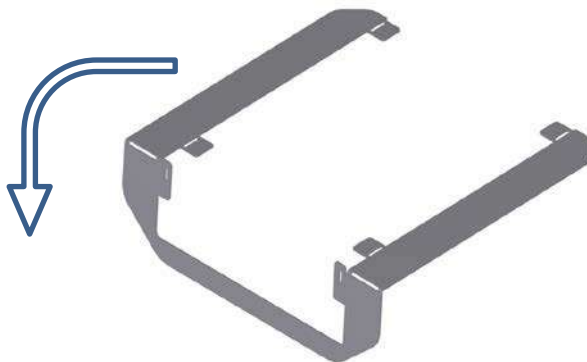


Step 2.

Place the bent liner inside the lid of the boiler

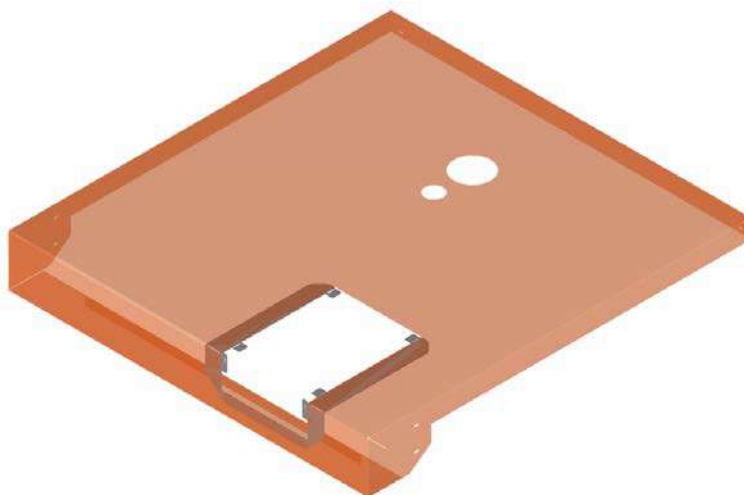


Step 3.

Fix the liner on the cover by bending 4 protrusions of the liner up 180°.

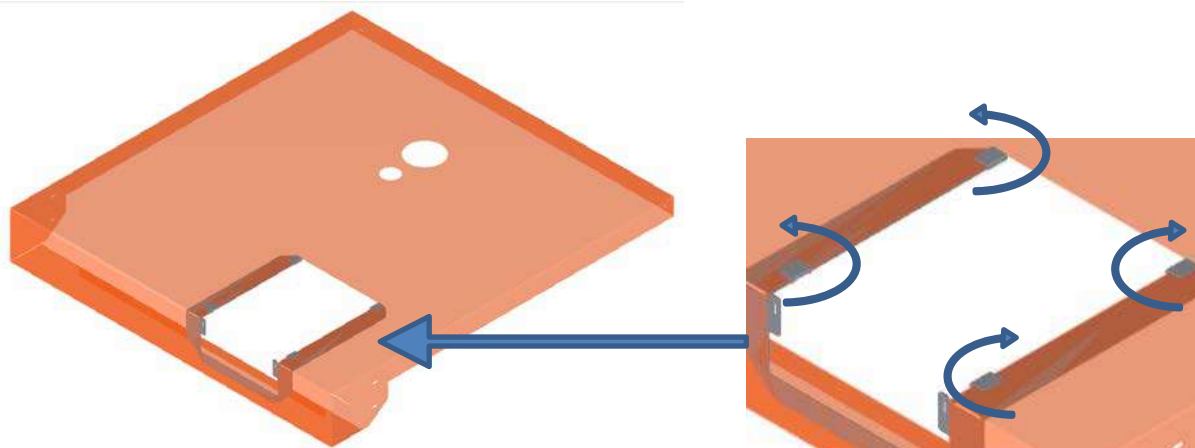

Step 4
Set up body of the regulator on the lid of the boiler

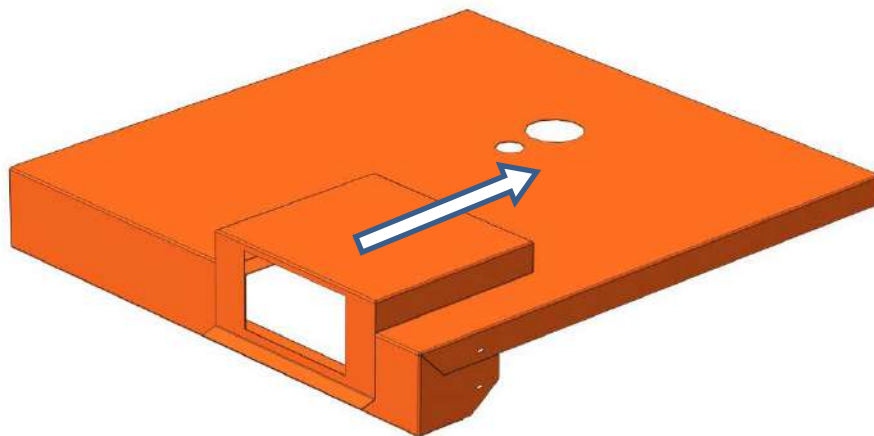

Step 5.
Screw in two screws, mount control panel of the regulator on the boiler's lid.

